
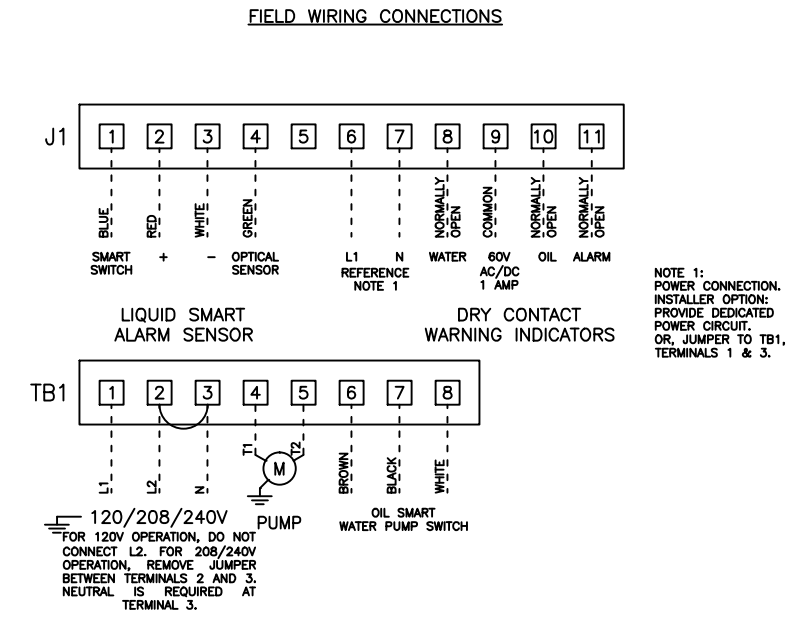
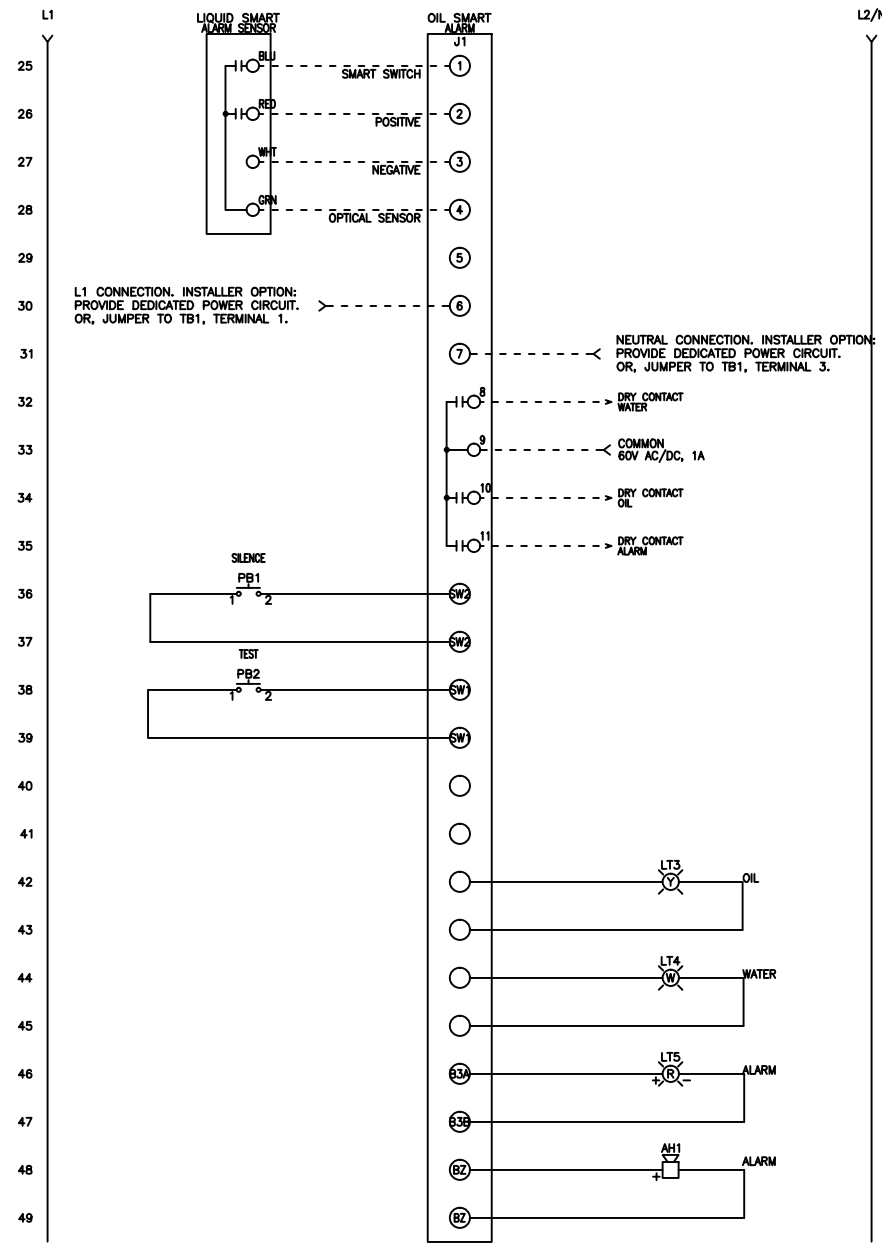


REVDATE: 0817 FNAME: OSSIM-30

REVISIONS				
ZONE	REV	DESCRIPTION	DATE	APPROVED
	A	RELOCATION OF CONTROL WIRING AFTER CIRCUIT BREAKER.	9/18/16	
	B	FIELD WIRING CHANGE FOR ALARM BOARD POWER CIRCUIT.	8/1/17	
	C	ADJUSTMENT OF CR1 TERMINALS	8/22/17	
	D	RELOCATION OF POWER ON LIGHT WIRING	8/31/17	

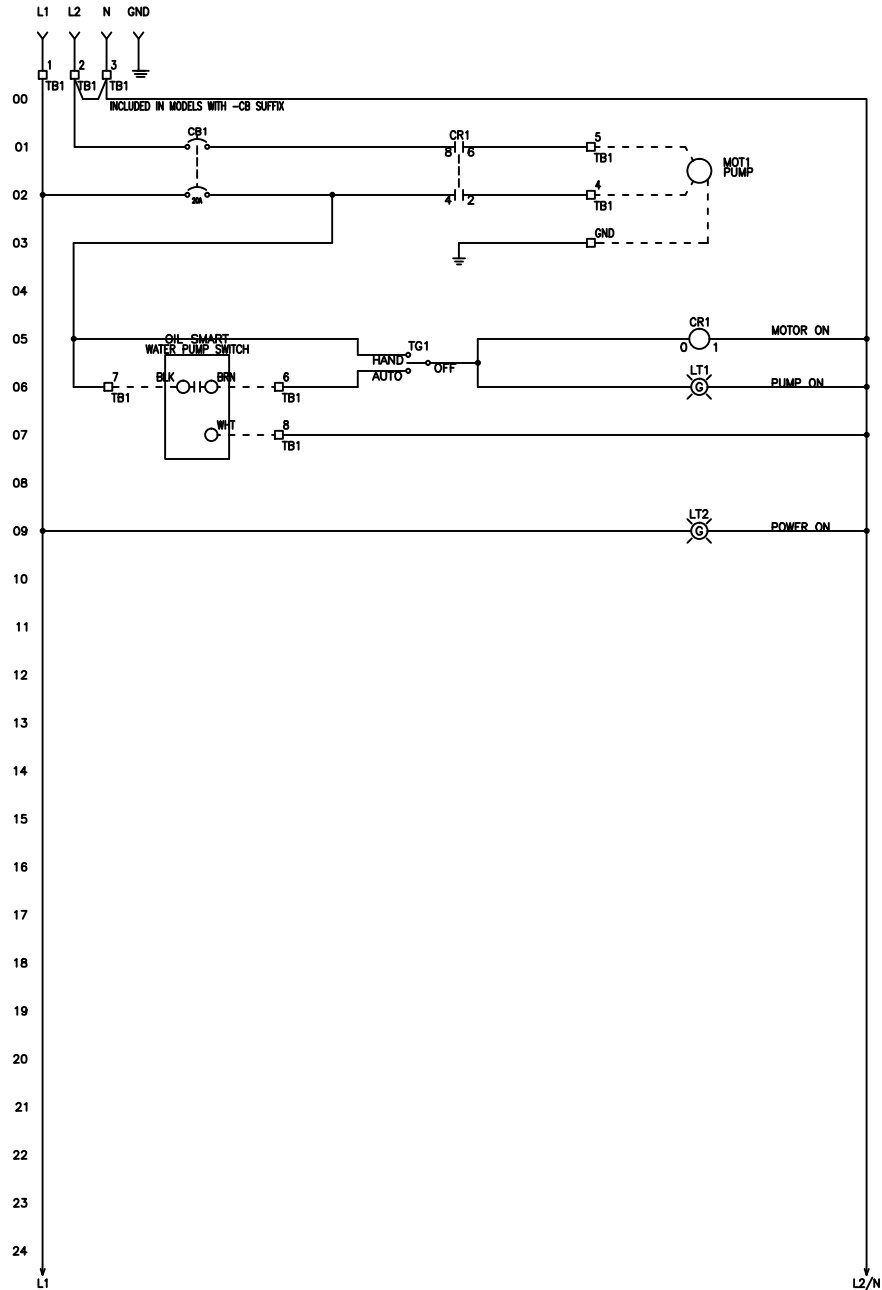

NOTE 1: POWER CONNECTION. INSTALLER OPTION: PROVIDE DEDICATED POWER CIRCUIT. OR, JUMPER TO TB1, TERMINALS 1 & 3.

----- DASHED LINE INDICATES FIELD WIRING.

USE COPPER CONDUCTORS ONLY.
 TEMPERATURE RATING OF CONDUCTORS IS TO BE 60°C (167°F).
 BRANCH CIRCUIT PROTECTION SHALL BE PROVIDED BY THE INSTALLER; MUST BE SIZED ACCORDING TO PUMP/MOTOR MANUFACTURING SPECIFICATIONS.
 VERIFY CORRECT OPERATION OF CONTROL PANEL AFTER INSTALLATION IS COMPLETE.

DRAWN BY: MM DATE: 6/30/14
 APPROVED BY: DATE:



THIS DRAWING CONTAINS PROPRIETARY INFORMATION AND SHALL NOT BE USED OR DISCLOSED WITHOUT PRIOR WRITTEN AUTHORIZATION.

TITLE: OSSIM-30 CONTROL SCHEMATIC				
SIZE B	DWG NO. 1511	PART NO. OSSIM-30	REV D	
SCALE NONE	SHEET 1 OF 1			