
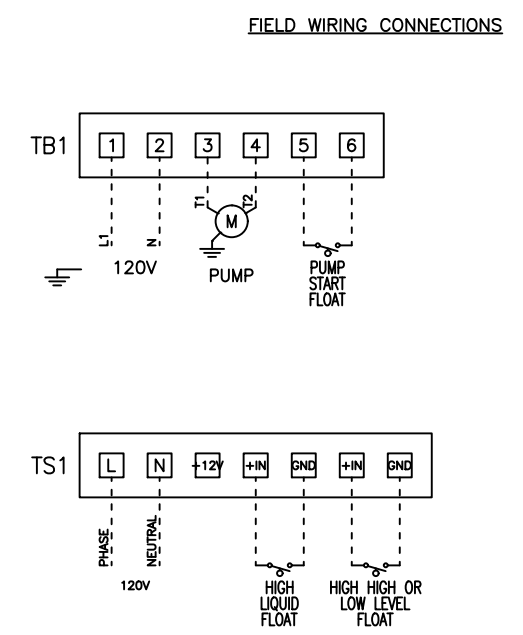
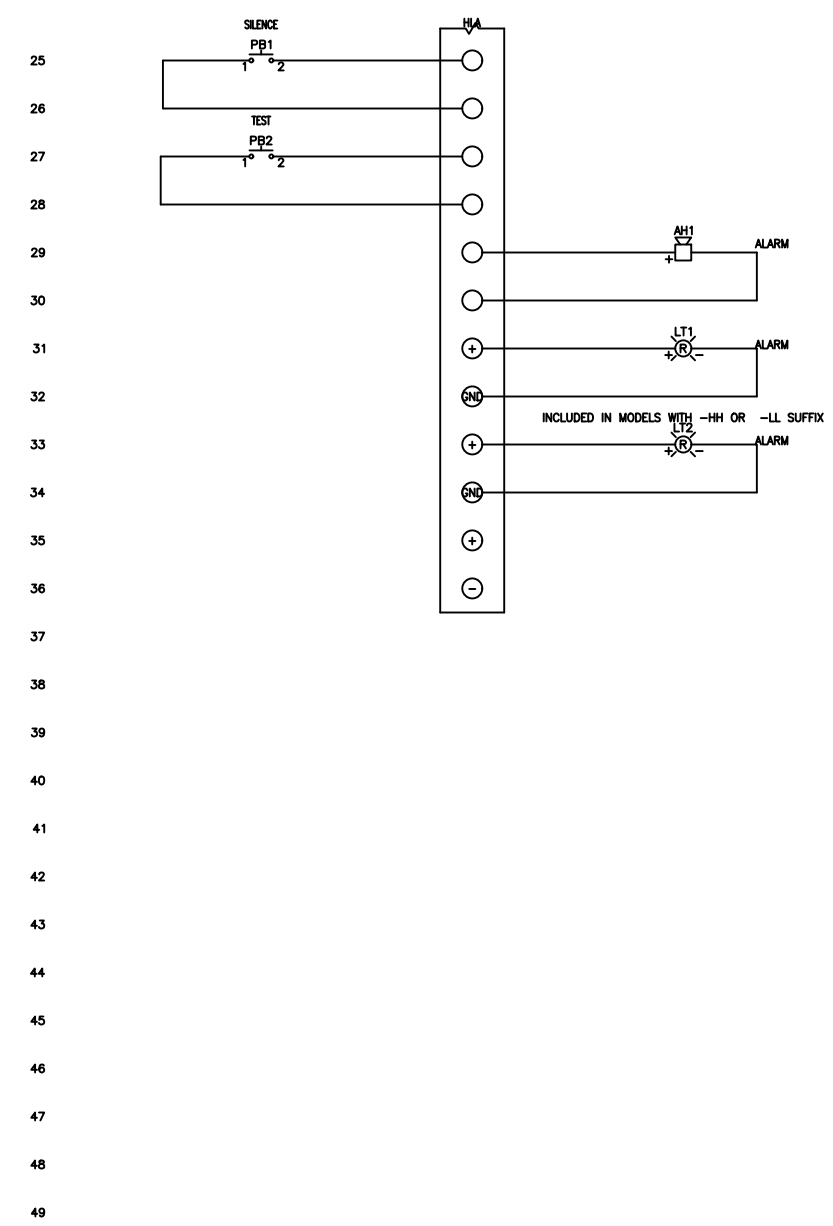


REVDATE: 0215 FNAME: SSP-1

REVISIONS				
ZONE	REV	DESCRIPTION	DATE	APPROVED

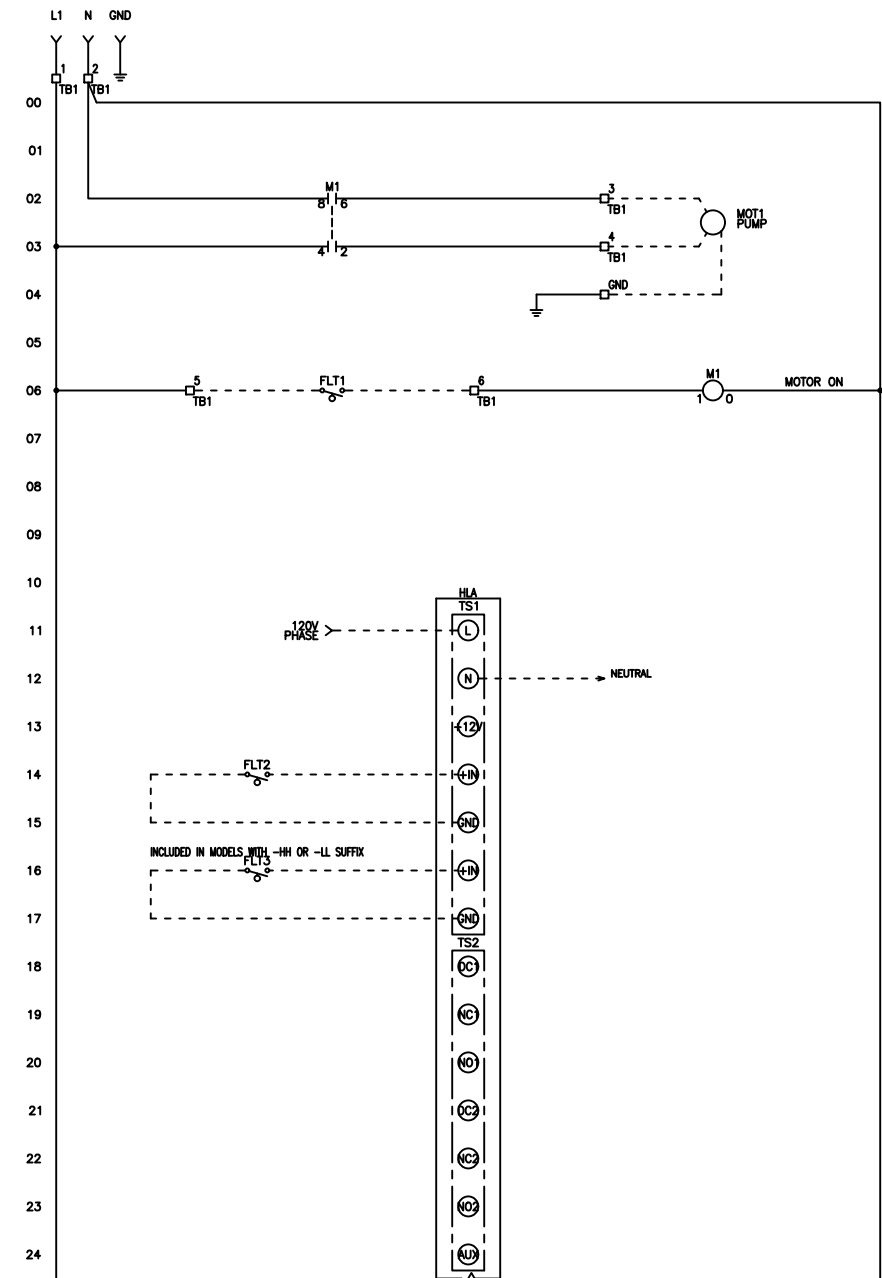

----- DASHED LINE INDICATES FIELD WIRING.

USE COPPER CONDUCTORS ONLY.  
TEMPERATURE RATING OF CONDUCTORS IS TO BE 60°C (167°F).  
BRANCH CIRCUIT PROTECTION SHALL BE PROVIDED BY THE INSTALLER; MUST BE SIZED ACCORDING TO PUMP/MOTOR MANUFACTURING SPECIFICATIONS.  
VERIFY CORRECT OPERATION OF CONTROL PANEL AFTER INSTALLATION IS COMPLETE.

DRAWN BY: MM	DATE: 2/24/15	<b>SEEWATER</b> <i>Inc.</i>			
APPROVED BY:	DATE:				
THIS DRAWING CONTAINS PROPRIETARY INFORMATION AND SHALL NOT BE USED OR DISCLOSED WITHOUT PRIOR WRITTEN AUTHORIZATION.		TITLE: SSP-1 CONTROL SCHEMATIC			
		SIZE B	DWG NO. 1541	PART NO. SSP-1	REV
		SCALE NONE	SHEET 1 OF 1		