


FNAME: WD3P-4-302X
REVDATE: 0118

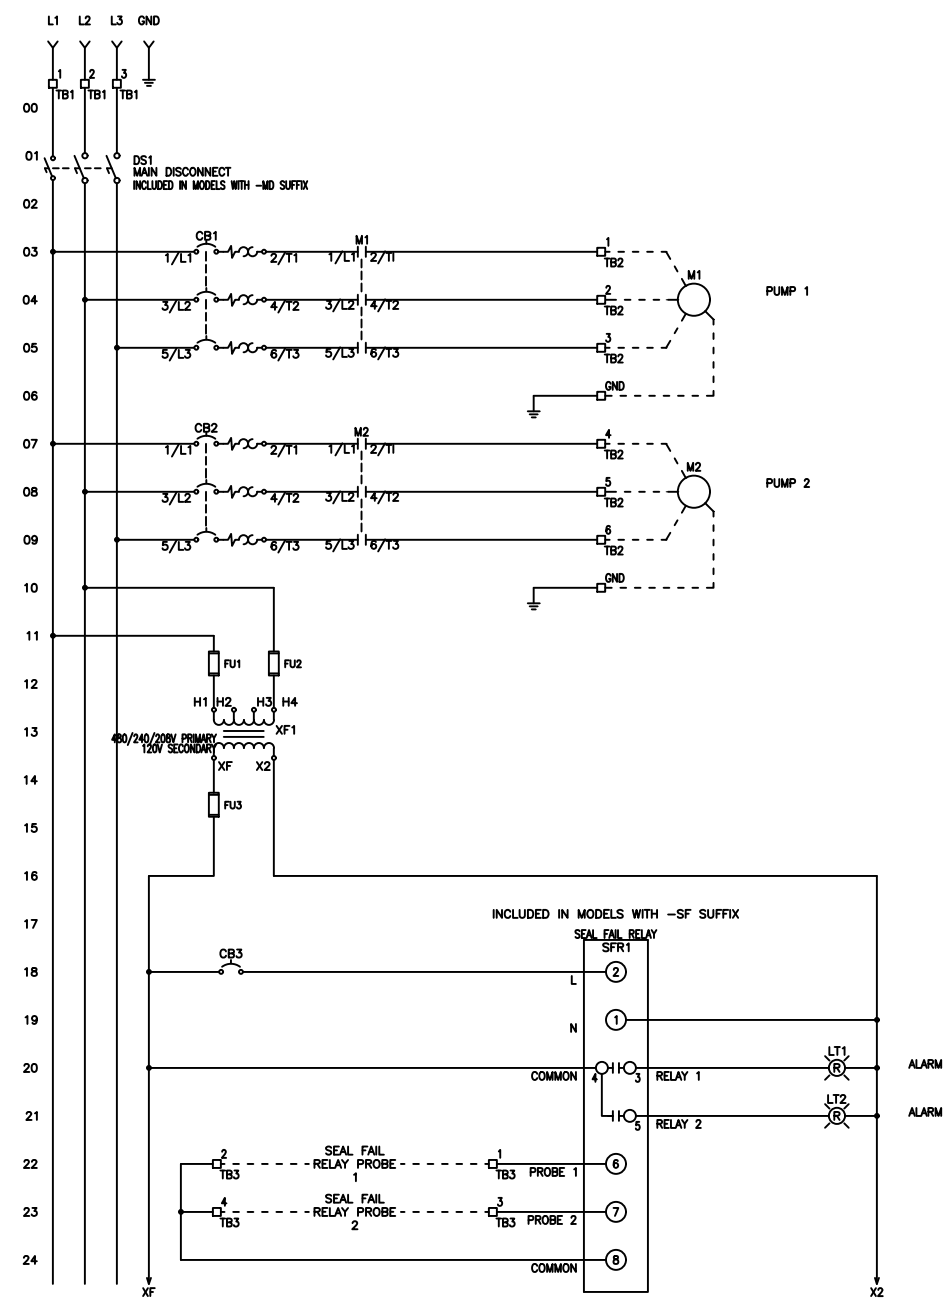


MULTITAP TRANSFORMER INSTRUCTIONS:
CONNECT FACTORY TAGGED WIRES TO APPROPRIATE TRANSFORMER VOLTAGE TAP. SEE BELOW FOR CONNECTIONS:
FOR 208V OPERATION, CONNECT TO FUSE INPUT HF & TO TRANSFORMER TAP H2
FOR 240V OPERATION, CONNECT TO FUSE INPUT HF & TO TRANSFORMER TAP H3
FOR 480V OPERATION, CONNECT TO FUSE INPUT HF & TO TRANSFORMER TAP H4

----- DASHED LINE INDICATES FIELD WIRING.

USE COPPER CONDUCTORS ONLY.
TEMPERATURE RATING OF CONDUCTORS IS TO BE 60°C (167°F).
BRANCH CIRCUIT PROTECTION SHALL BE PROVIDED BY THE INSTALLER. MUST BE SIZED ACCORDING TO PUMP/MOTOR MANUFACTURING SPECIFICATIONS.
VERIFY CORRECT OPERATION OF CONTROL PANEL AFTER INSTALLATION IS COMPLETE.

REVISIONS				
ZONE	REV	DESCRIPTION	DATE	APPROVED
	A	ADDITION OF OPTIONAL SEAL FAIL RELAY	1/11/15	
	B	ADDITION OF OPTIONAL LOW LEVEL ALARM	5/2/16	
	C	UPDATED INSTRUCTIONS	5/24/17	
	D	UPDATED TERMINAL BLOCKS & CIRCUIT BREAKER	8/25/17	
	E	REVISED CBS AND UPDATED POWER ON LIGHT	9/21/17	
	F	REVISED SEAL FAIL RELAY	1/9/18	
	G	Transformer Label X1 to XF	4/29/19	

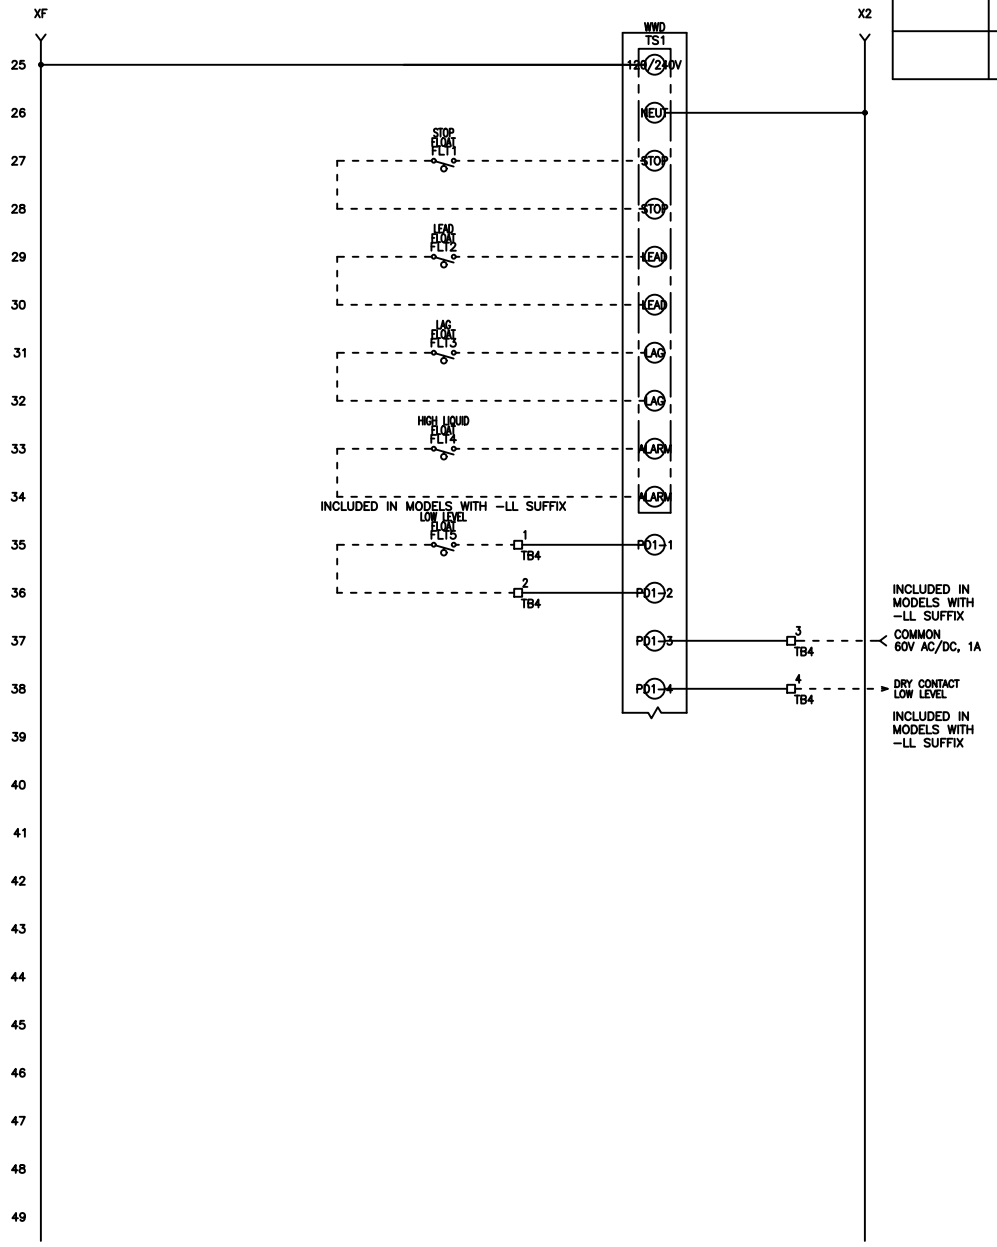

DRAWN BY: KJ
DATE: 11/6/14
APPROVED BY: [Signature]


THIS DRAWING CONTAINS PROPRIETARY INFORMATION AND SHALL NOT BE USED OR DISCLOSED WITHOUT PRIOR WRITTEN AUTHORIZATION.



TITLE: WD3P-4-302X CONTROL SCHEMATIC				
SIZE: B	DWG NO.: 1526	PART NO.: WD3P-4-302X	REV: G	
SCALE: NONE	SHEET: 1 OF 3			

FRAME: WD3P-4-302X

REVDATE: 0118

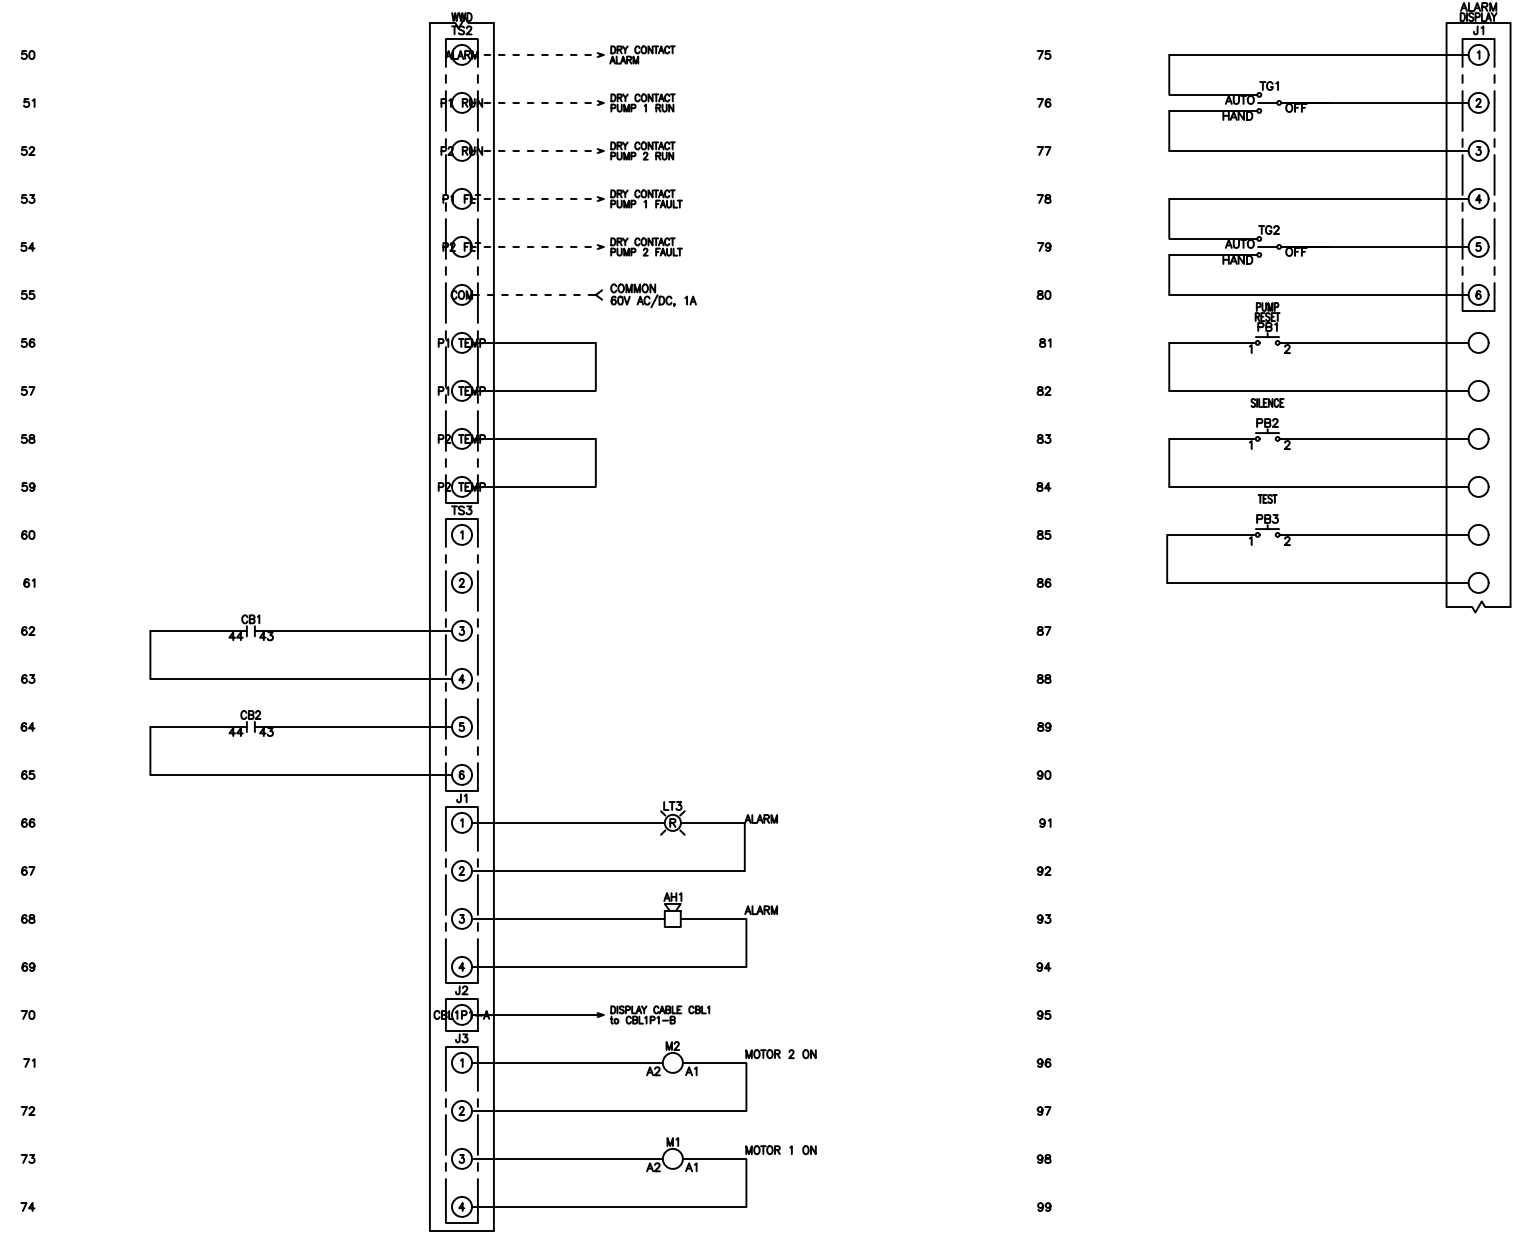

REVISIONS				
ZONE	REV	DESCRIPTION	DATE	APPROVED
	A	ADDITION OF OPTIONAL SEAL FAIL RELAY	1/11/15	
	B	ADDITION OF OPTIONAL LOW LEVEL ALARM	5/2/16	
	C	UPDATED INSTRUCTIONS	5/24/17	
	D	UPDATED TERMINAL BLOCKS & CIRCUIT BREAKER	8/25/17	
	E	REVISED CBS AND UPDATED POWER ON LIGHT	9/21/17	
	F	REVISED SEAL FAIL RELAY	1/9/18	
	G	Transformer Label X1 to XF	4/29/19	

MULTITAP TRANSFORMER INSTRUCTIONS:

CONNECT FACTORY TAGGED WIRES TO APPROPRIATE TRANSFORMER VOLTAGE TAP. SEE BELOW FOR CONNECTIONS:

FOR 208V OPERATION, CONNECT TO FUSE INPUT HF & TO TRANSFORMER TAP H2

FOR 240V OPERATION, CONNECT TO FUSE INPUT HF & TO TRANSFORMER TAP H3

FOR 480V OPERATION, CONNECT TO FUSE INPUT HF & TO TRANSFORMER TAP H4

----- DASHED LINE INDICATES FIELD WIRING.

USE COPPER CONDUCTORS ONLY.

TEMPERATURE RATING OF CONDUCTORS IS TO BE 60°C (167°F).


BRANCH CIRCUIT PROTECTION SHALL BE PROVIDED BY THE INSTALLER. MUST BE SIZED ACCORDING TO PUMP/MOTOR MANUFACTURING SPECIFICATIONS.

VERIFY CORRECT OPERATION OF CONTROL PANEL AFTER INSTALLATION IS COMPLETE.

DRAWN BY: KJ	DATE: 11/6/14	SEEWATER <i>Inc.</i>			
APPROVED BY:	DATE:				
THIS DRAWING CONTAINS PROPRIETARY INFORMATION AND SHALL NOT BE USED OR DISCLOSED WITHOUT PRIOR WRITTEN AUTHORIZATION.		TITLE: WD3P-4-302X CONTROL SCHEMATIC			
		SIZE B	DWG NO. 1526	PART NO. WD3P-4-302X	REV G
		SCALE NONE	SHEET 2 OF 3		


FRAME: WD3P-4-302X

REVDATE: 0118

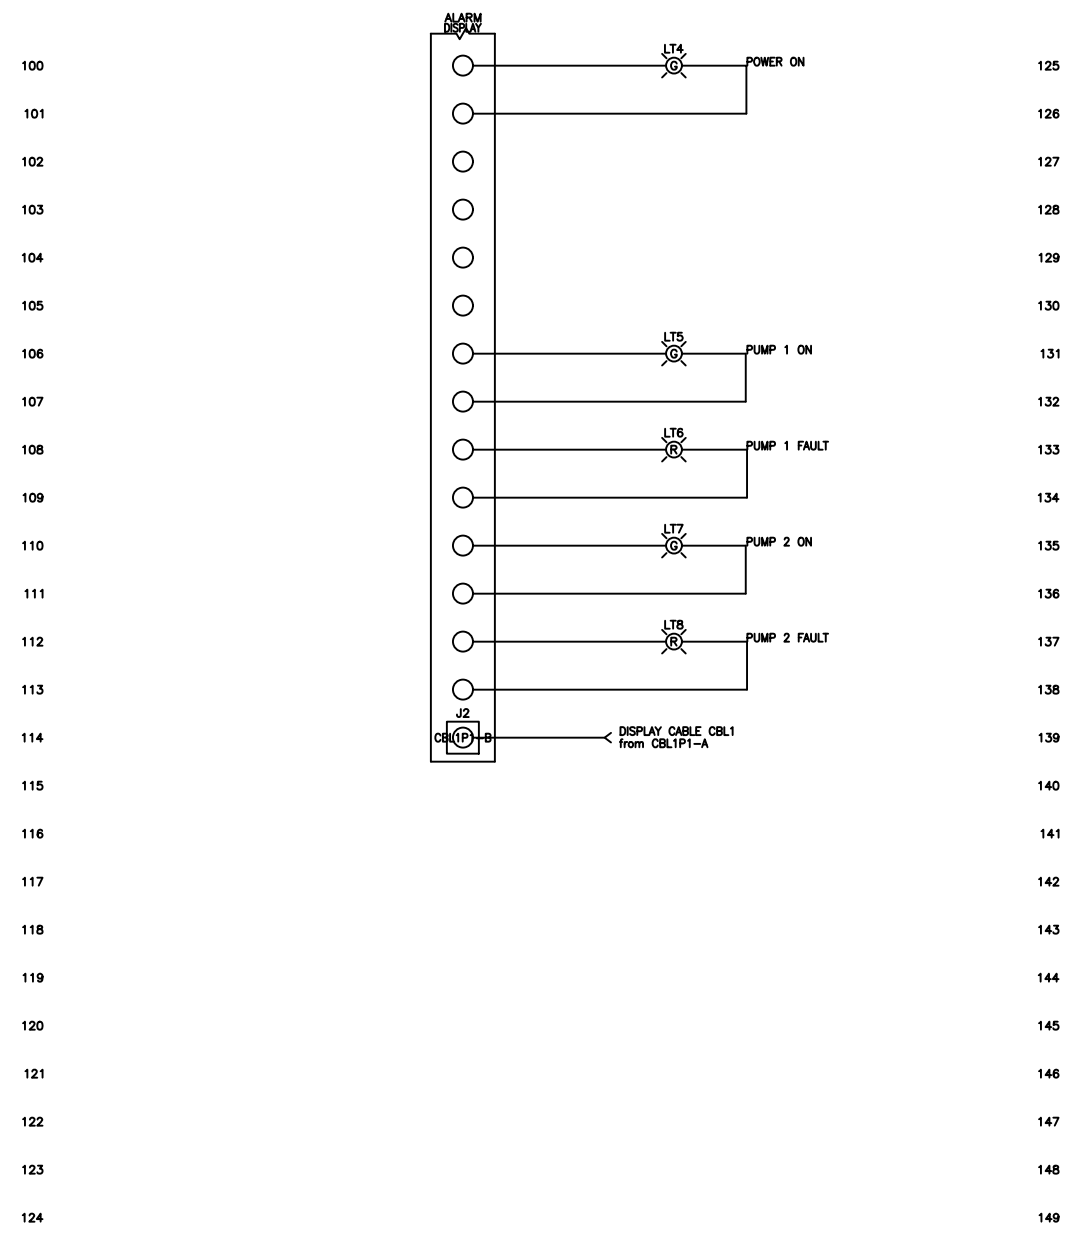

REVISIONS				
ZONE	REV	DESCRIPTION	DATE	APPROVED
	A	ADDITION OF OPTIONAL SEAL FAIL RELAY	1/11/15	
	B	ADDITION OF OPTIONAL LOW LEVEL ALARM	5/2/16	
	C	UPDATED INSTRUCTIONS	5/24/17	
	D	UPDATED TERMINAL BLOCKS & CIRCUIT BREAKER	8/25/17	
	E	REVISED CBS AND UPDATED POWER ON LIGHT	9/21/17	
	F	REVISED SEAL FAIL RELAY	1/9/18	
	G	Transformer Label X1 to XF	4/29/19	

FIELD WIRING CONNECTIONS

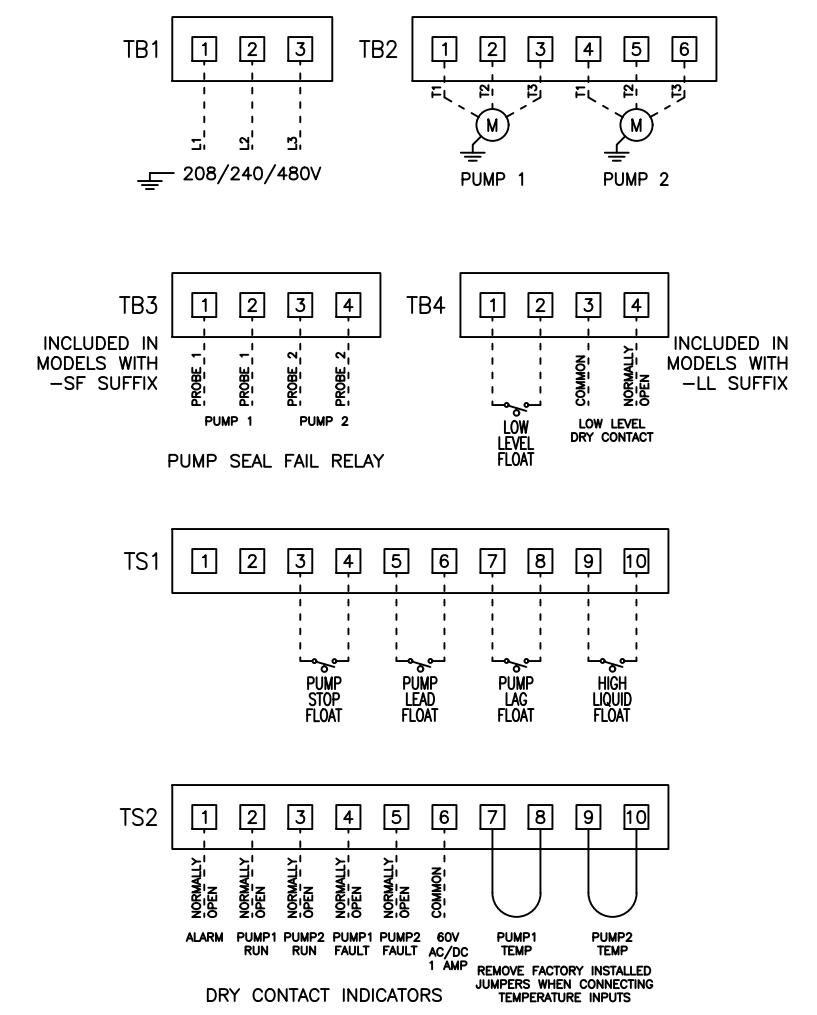

MULTITAP TRANSFORMER INSTRUCTIONS:

CONNECT FACTORY TAGGED WIRES TO APPROPRIATE TRANSFORMER VOLTAGE TAP. SEE BELOW FOR CONNECTIONS:

FOR 208V OPERATION, CONNECT TO FUSE INPUT HF & TO TRANSFORMER TAP H2

FOR 240V OPERATION, CONNECT TO FUSE INPUT HF & TO TRANSFORMER TAP H3

FOR 480V OPERATION, CONNECT TO FUSE INPUT HF & TO TRANSFORMER TAP H4

----- DASHED LINE INDICATES FIELD WIRING.

USE COPPER CONDUCTORS ONLY.

TEMPERATURE RATING OF CONDUCTORS IS TO BE 60°C (167°F).

BRANCH CIRCUIT PROTECTION SHALL BE PROVIDED BY THE INSTALLER. MUST BE SIZED ACCORDING TO PUMP/MOTOR MANUFACTURING SPECIFICATIONS.

VERIFY CORRECT OPERATION OF CONTROL PANEL AFTER INSTALLATION IS COMPLETE.

DRAWN BY: KJ
DATE: 11/6/14

APPROVED BY: _____
DATE: _____



THIS DRAWING CONTAINS PROPRIETARY INFORMATION AND SHALL NOT BE USED OR DISCLOSED WITHOUT PRIOR WRITTEN AUTHORIZATION.

TITLE: WD3P-4-302X CONTROL SCHEMATIC			
SIZE: B	DWG NO.: 1526	PART NO.: WD3P-4-302X	REV: G
SCALE: NONE	SHEET: 3 OF 3		